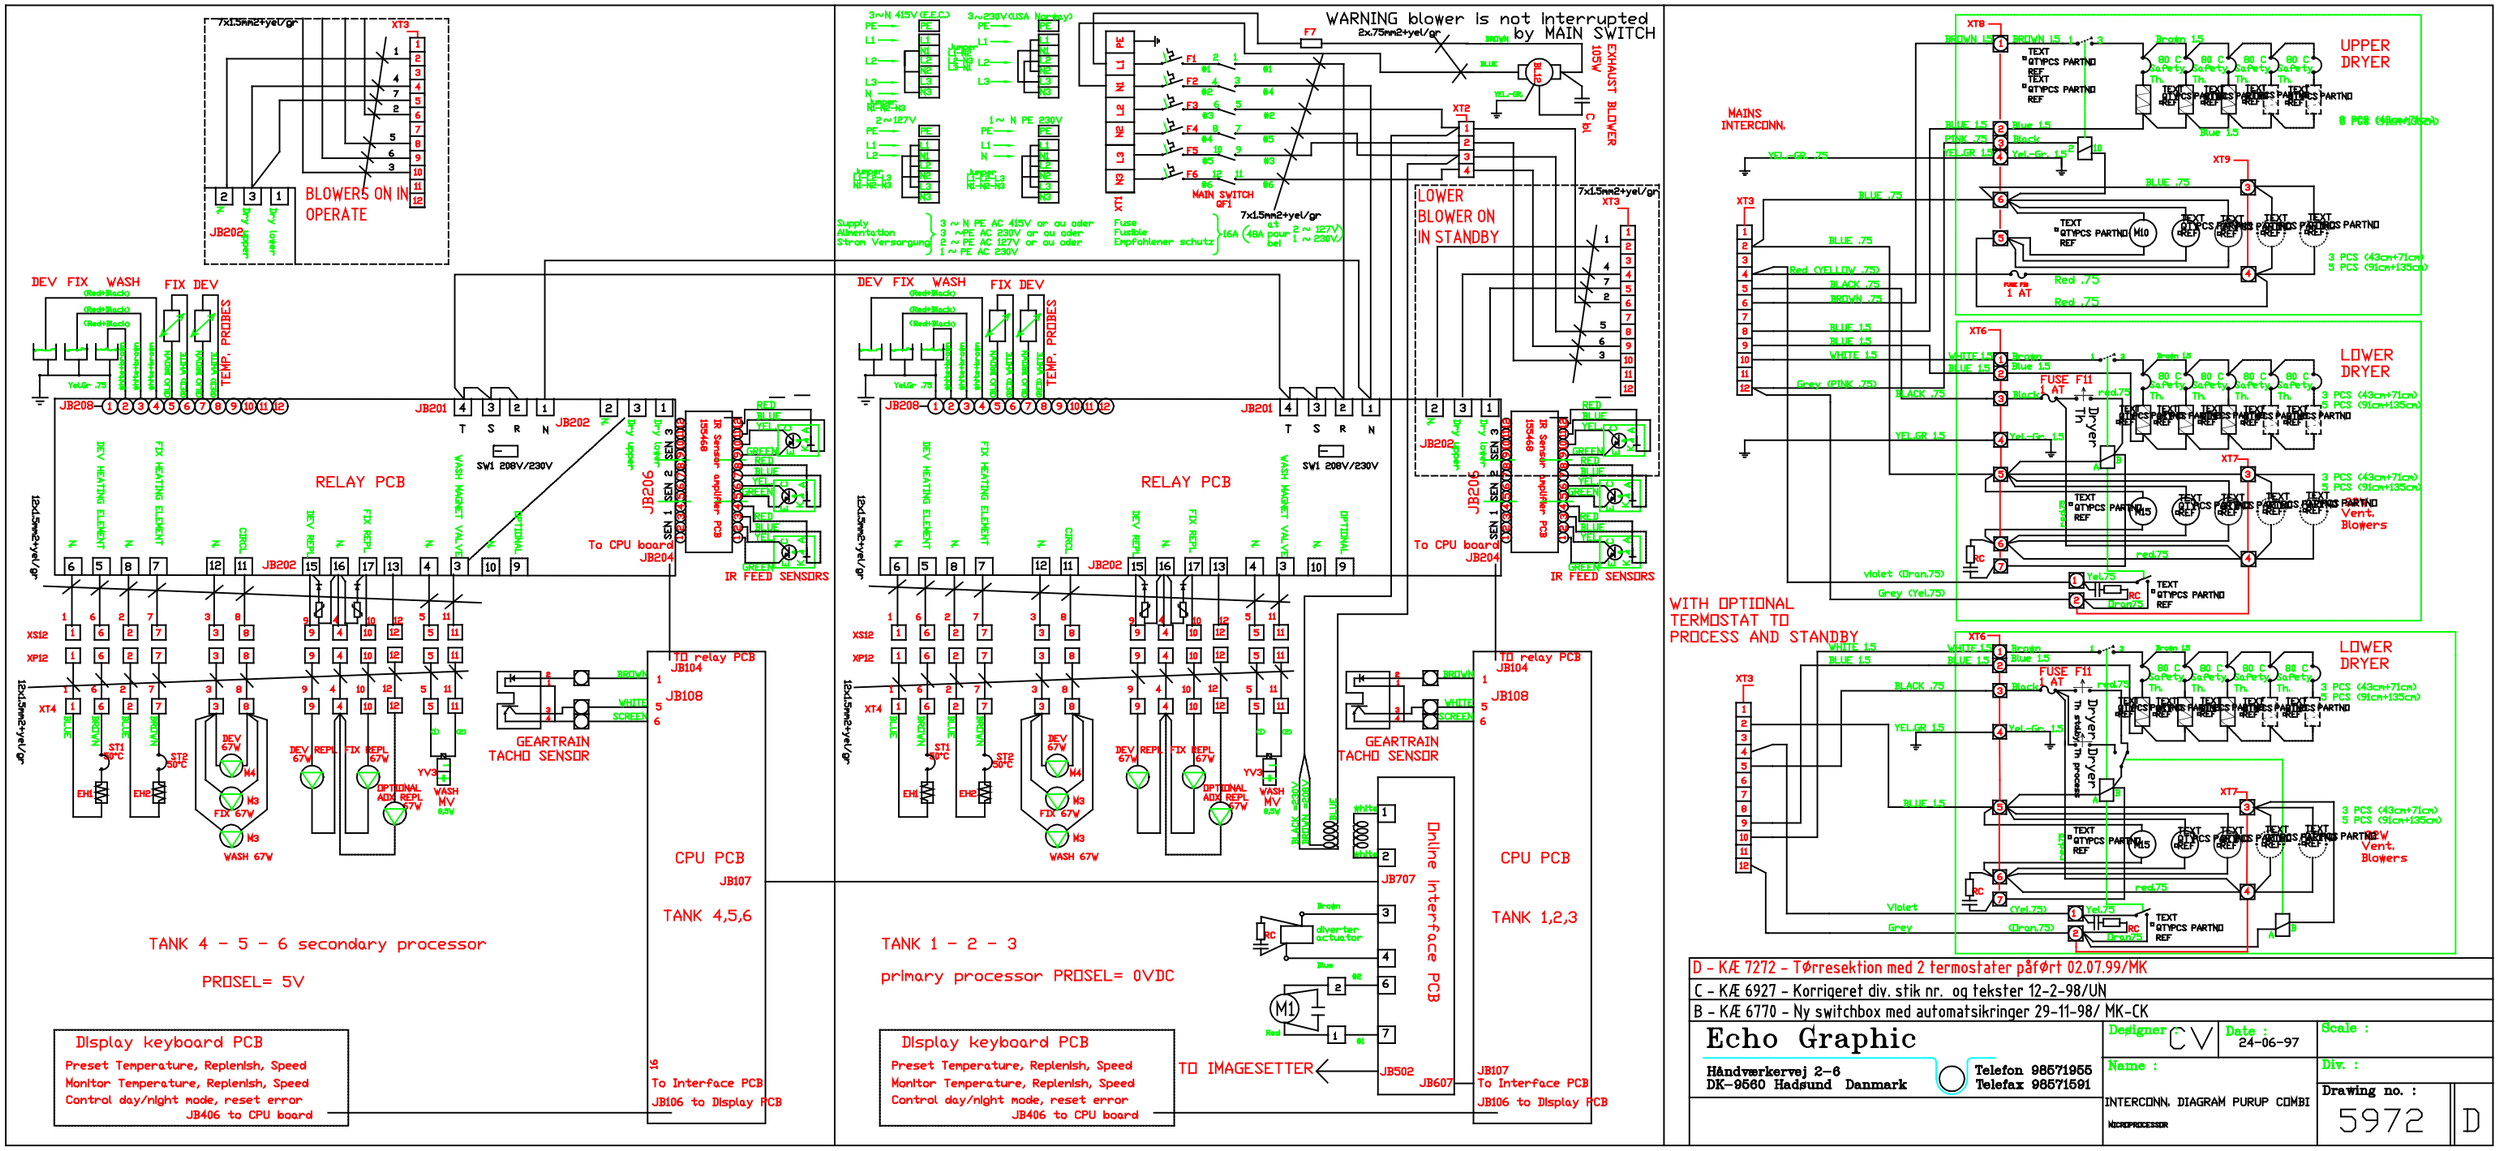
WARNING blower is not interrupted by MAIN SWITCH
BLOWERS ON IN OPERATE
LOWER BLOWER ON IN STANDBY
EXHAUST BLOWER 105V
MAIN SWITCH QF1
RELAY PCB
CPU PCB
TANK 4,5,6
TANK 1,2,3
TANK 4 - 5 - 6 secondary processor
PROSEL= 5V
TANK 1 - 2 - 3
primary processor PROSEL= 0VDC
Display keyboard PCB
Preset Temperature, Replenish, Speed
Monitor Temperature, Replenish, Speed
Control day/night mode, reset error
JB406 to CPU board
GEARTRAIN TACHO SENSOR
IR FEED SENSORS
Online Interface PCB
TO IMAGESETTER
To Interface PCB
JB106 to Display PCB
MAINS INTERCONN.
UPPER DRYER
LOWER DRYER
WITH OPTIONAL TERMOSTAT TO PROCESS AND STANDBY
D - KÆ 7272 - Tørresektion med 2 termostater påført 02.07.99/MK
C - KÆ 6927 - Korrigeret div. stik nr. og tekster 12-2-98/UN
B - KÆ 6770 - Ny switchbox med automatsikringer 29-11-98/ MK-CK
Echo Graphic
Håndværkervej 2-6
DK-9560 Hadsund Danmark
Telefon 98571955
Telefax 98571591
Designer CV
Date : 24-06-97
Scale :
Name :
INTERCONN. DIAGRAM PURUP COMBI
MICROPROCESSOR
Div. :
Drawing no. : 5972
D